Market analysis

25–31 March 2007

Spot prices for the week averaged between \$38/MWh in Queensland and \$51/MWh in Tasmania, This represented a significant reduction in almost all regions compared to the previous week, consistent with milder weather conditions.

AUSTRALIAN ENERGY

REGULATOR

Turnover in the energy market was \$156 million. The total cost of ancillary services for the week was \$270 000, or 0.2 per cent of energy market turnover.

Significant variations between actual prices and those forecast 4 and 12 hours ahead occurred in 30 or nine per cent of all trading intervals. Demand forecasts produced 4 and 12 hours ahead varied from actual by more than 5 per cent in around a fifth of all trading intervals across the market. These variations were most frequent in South Australia, occurring in 43 per cent all trading intervals.

Energy prices

Figure 1 sets out the national demand and spot prices in each region for each trading interval. Figure 2 compares the volume weighted average price with the averages for the previous week, the same quarter last year and for the previous financial year.

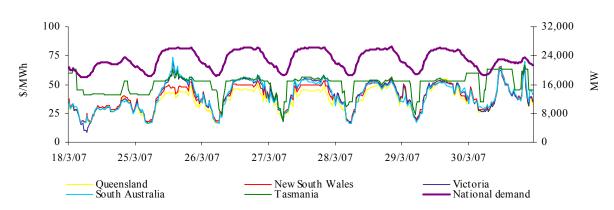


Figure 1: national demand and spot prices

Figure 2: volume weighted average spot price for energy market (\$/MWh)

		0.	(·		
	QLD	NSW	VIC	SA	TAS
Last week	38	41	42	42	51
Previous week	60	83	77	61	56
Same quarter last year	38	45	53	57	33
Financial year to date	37	41	48	51	43
% change from previous week *	▼36%	▼51%	▼46%	▼31%	▼8%
% change from same quarter last year **	▼ 1%	▼ 11%	▼ 21%	▼27%	▲55%
% change from year to date ***	▲ 10%	▼ 15%	▲25%	▲ 11%	▼36%

*The percentage change between last week's average spot price and the average price for the previous week.

**The percentage change between last week's average spot price and the average price for the same quarter last year.

***The percentage change between the average spot price for the current financial year to date and the average spot price over the similar period for the previous financial year.




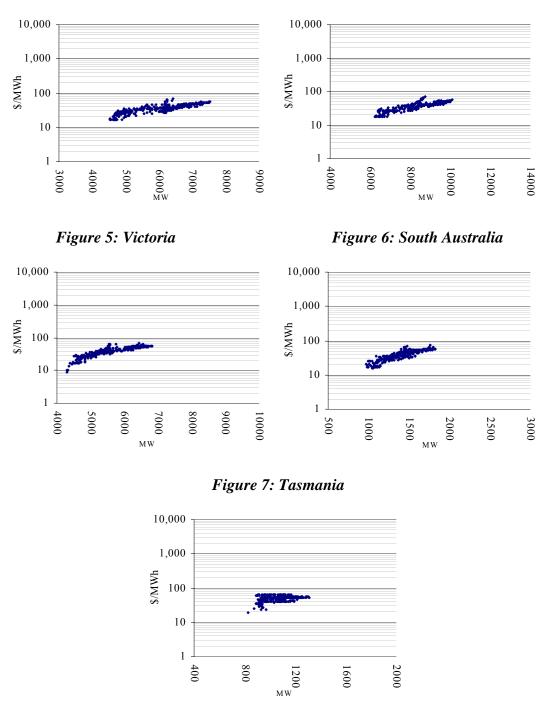


Figure 3: Queensland



The maximum spot prices for the week ranged from \$66/MWh in Tasmania to \$73/MWh in South Australia. Figure 8 compares the weekly price volatility index with the averages for the previous week and the same quarter last year.

1600

2000

400

008

Figure 8: volatility index during peak periods

	QLD	NSW	VIC	SA	TAS
Last week	0.29	0.24	0.27	0.32	0.06
Previous week	1.26	2.13	1.58	1.58	0.32
Same quarter last year	1.07	0.96	0.96	0.94	0.29

The definition of the price volatility index is available on the AER website.

http://www.aer.gov.au/content/index.phtml/tag/MarketSnapshotLongTermAnalysis


Figure 9 sets out the d-cyphaTrade wholesale electricity price index (WEPI)* for each region throughout the week excluding Tasmania. Figure 10 sets out the WEPI since 1 January 2005.


Figure 9: d-cyphaTrade WEPI for the week

	Monday	Tuesday	Wednesday	Thursday	Friday
Queensland	57.29	57.96	59.37	59.94	60.51
New South Wales	52.21	53.12	53.01	53.82	53.58
Victoria	54.36	56.17	55.87	56.04	56.21
South Australia	51.66	52.55	51.40	51.07	51.29

* The definition of the wholesale electricity price index is available on the d-cyphaTrade website http://www.d-cyphatrade.com.au/products/wholesale_electricity_price_i

The WEPI applies for working days only.



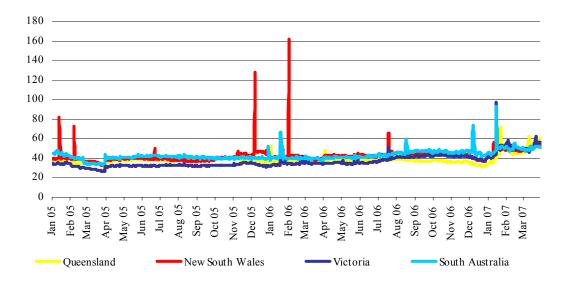

Reserve

There were no low reserves forecast.

Figures 11 to 15 show the spot price, net import and limit for each region at time of weekly maximum demand.




Figure 11: Queensland

Figure 12: New South Wales




Figure 14: South Australia






Figure 15: Tasmania


100

10

Figure 13: Victoria








© Commonwealth of Australia.

Price variations

There were 30 trading intervals where actual prices significantly varied from forecasts made 4 and 12 hours ahead of dispatch. Figures 16 to 20 show the difference in actual and forecast price versus the difference in actual and forecast demand. The figures highlight the relationship between price variation and demand forecast error. The information is presented in terms of the percentage difference from actual. Price differences beyond 100 per cent have been capped.

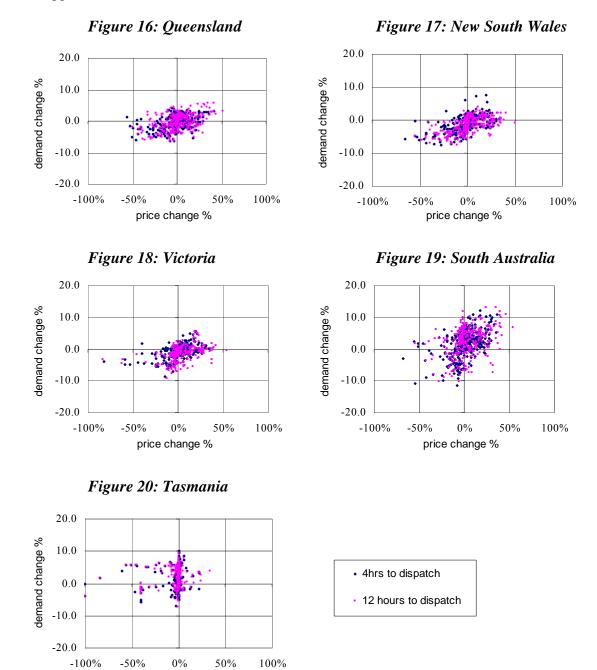

price change %

Figure 21 summarises the number and most probable reason for variations between forecast and actual prices.

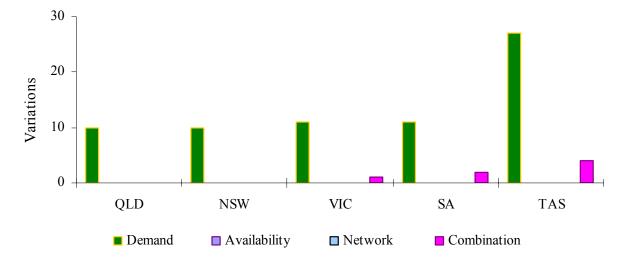



Figure 21: reasons for variations between forecast and actual prices


Price and demand

Figures 22 - 56 set out details of spot prices and demand on a national and regional basis. They include the actual spot price, actual demand and variation from forecasts made 4 and 12 hours ahead of dispatch.

Spot prices within the national market are regularly aligned, with conditions in one region reflected across all others. The national market outcomes section highlights pricing events that occurred when spot prices were generally aligned across all regions of the national electricity market – the New South Wales spot price has been used to represent a pseudo national price under these conditions.

On a regional basis the differences between the maximum temperature and the temperature forecast at around 6.00 pm the day before are also included. In each section, the occurrences of all prices for the week greater than three times the average have been presented. The price forecast is compared to the demand and availability forecasts made 4 and 12 hours ahead, with significant changes to these forecasts explained.



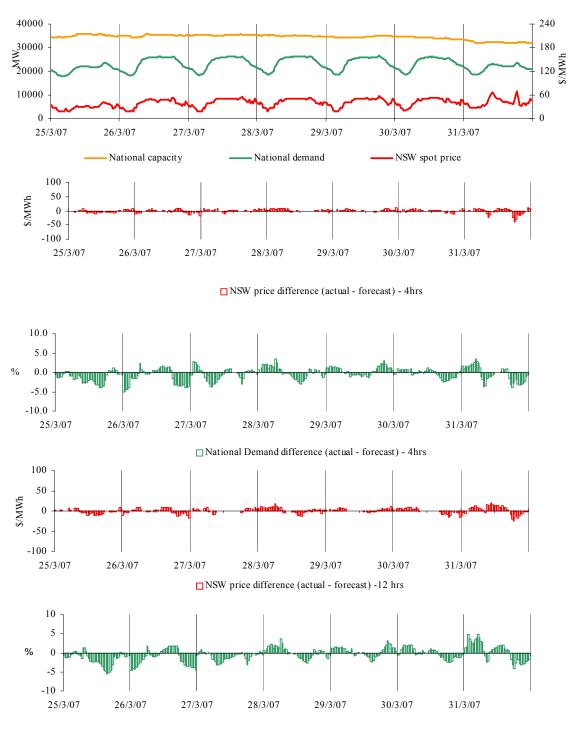


□ National Demand difference (actual - forecast) - 12hrs


There was no occasion where spot prices were nationally aligned and the New South Wales price¹ was greater than three times the New South Wales weekly average price of \$41/MWh.

¹ The New South Wales spot price has been used to represent a pseudo national price under these conditions.


Figures 27-32: Queensland actual spot price, demand and forecast differences

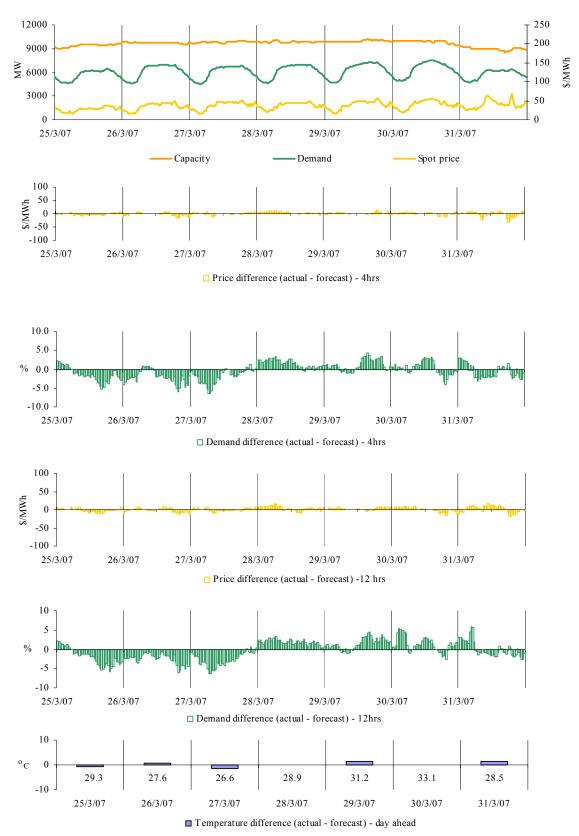


There was no occasion in Queensland where the spot price was greater than three times the weekly average price of \$38/MWh.

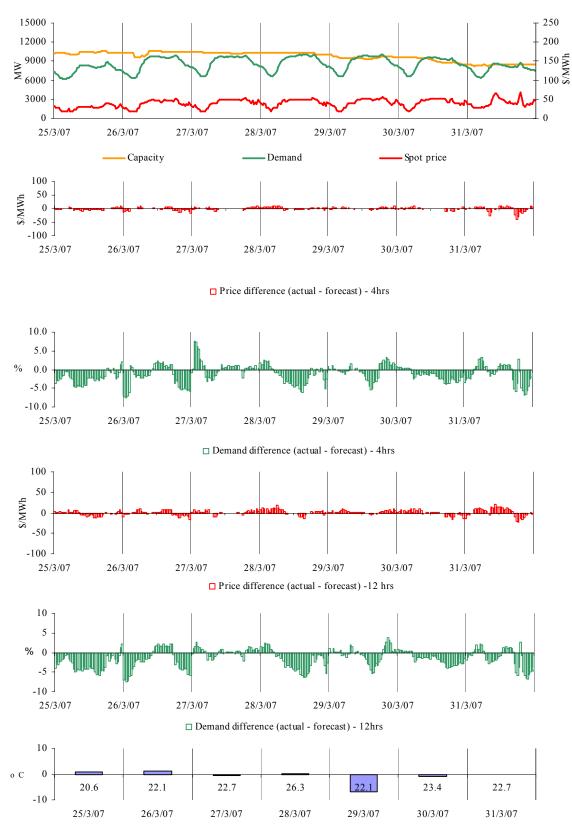


Figures 33-38 New South Wales actual spot price, demand and forecast differences



There was no occasion in New South Wales where the spot price was greater than three times the weekly average price of \$41/MWh.



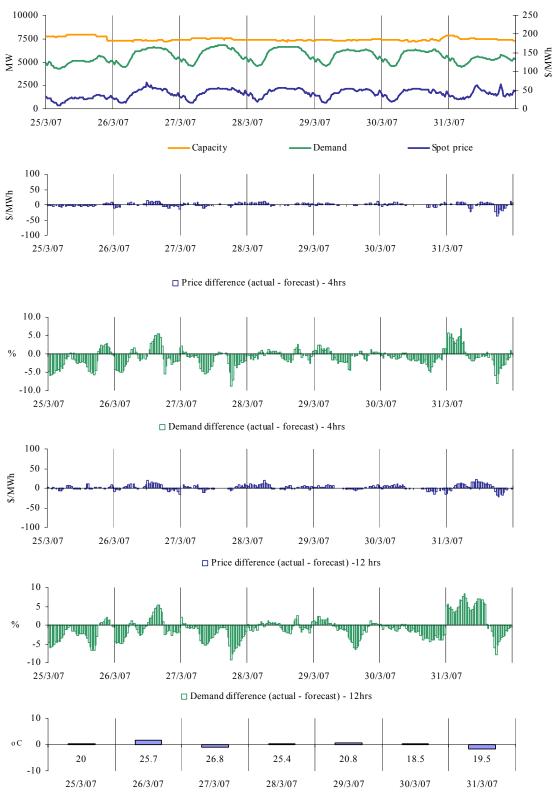


■ Temperature difference (actual - forecast) - day ahead

There was no occasion in Victoria where the spot price was greater than three times the weekly average price of \$42/MWh.




Figures 45-50: South Australia actual spot price, demand and forecast differences

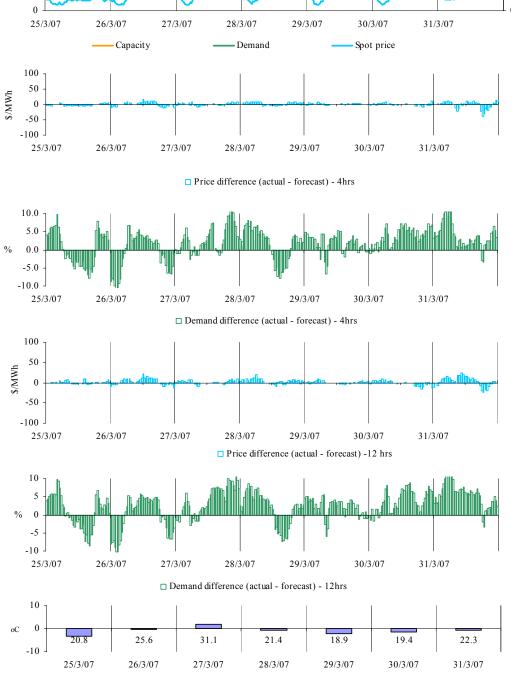

□ Temperature difference (actual - forecast) - day ahead

There was no occasion in South Australia where the spot price was greater than three times the weekly average price of \$42/MWh.

Figures 51-56: Tasmania actual spot price, demand and forecast differences

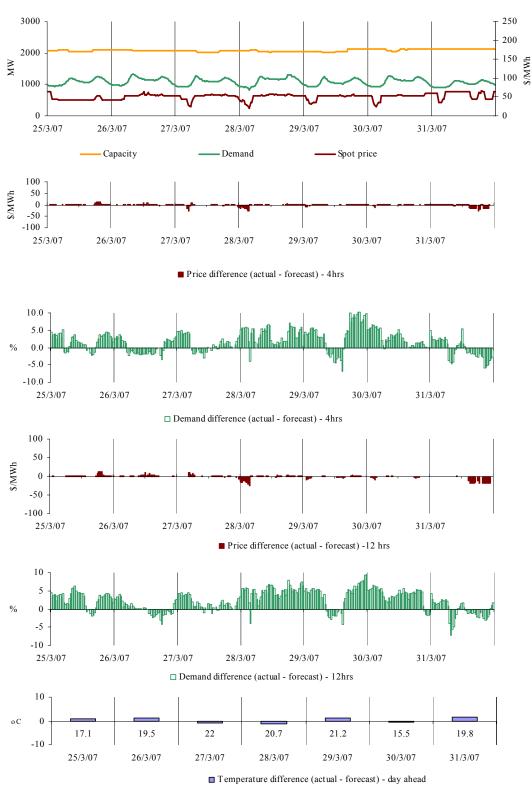

There was no occasion in Tasmania where the spot price was greater than three times the weekly average price of \$51/MWh.

Figures 57 - 61 set out for each region the extent of capacity offered into the market within a series of price thresholds. Actual price and generation dispatched in a region are overlaid.

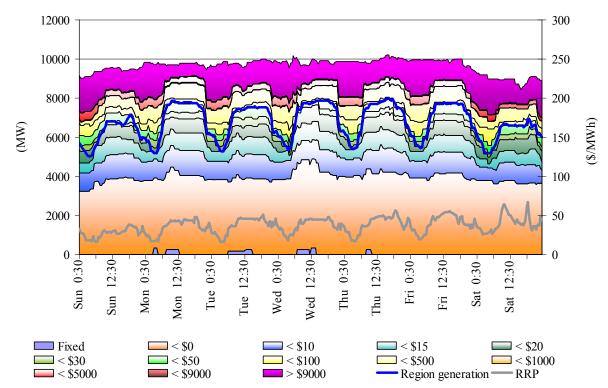
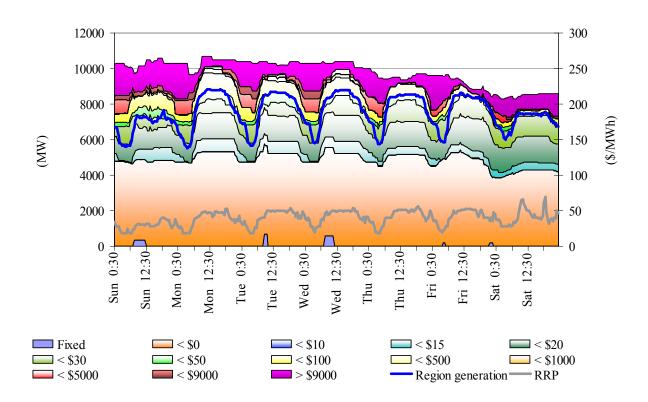


Figure 57: Queensland closing bid prices, dispatched generation and spot price

Figure 58: New South Wales closing bid prices, dispatched generation and spot price






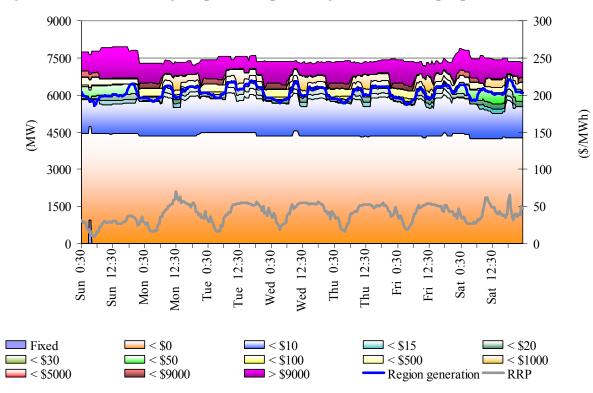


Figure 59: Victoria closing bid prices, dispatched generation and spot price

Figure 60: South Australia closing bid prices, dispatched generation and spot price

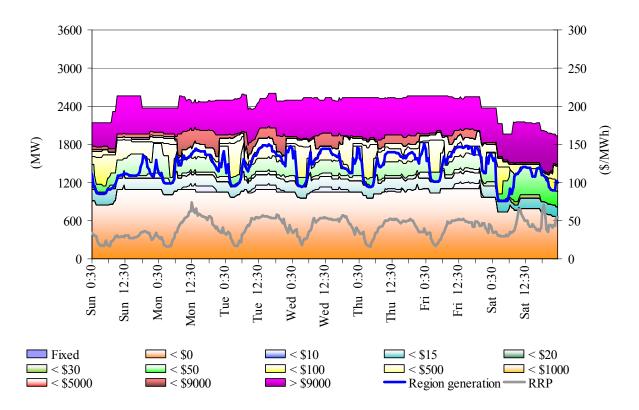



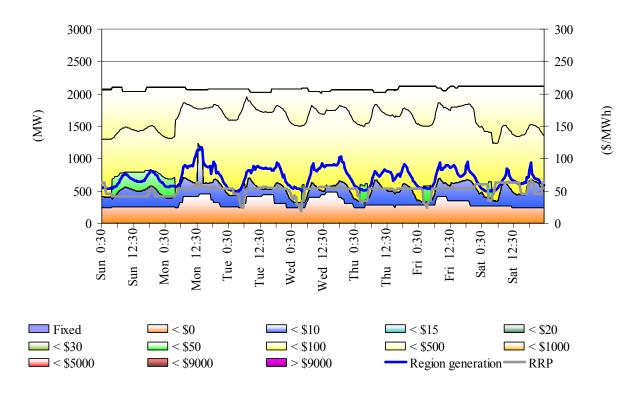

Ancillary service market

The total cost of ancillary services on the mainland for the week was \$193 000 or 0.1 per cent of the energy market. Figure 62 summarises the volume weighted average prices and costs for the eight frequency control ancillary services across the mainland.

	Raise	Raise	Raise	Raise	Lower	Lower	Lower	Lower
	6 sec	60 sec	5 min	Reg	6 sec	60 sec	5 min	reg
Last week (\$/MW)	0.83	0.28	0.85	2.18	0.06	0.53	1.23	1.38
Previous week (\$/MW)	0.62	0.32	1.03	2.31	0.10	0.49	1.29	0.98
Last quarter (\$/MW)	1.76	0.73	1.15	1.54	0.39	2.28	5.00	1.93
Market Cost (\$1000s)	\$34	\$9	\$45	\$44	\$0	\$7	\$34	\$20
% of energy market	0.02%	0.01%	0.03%	0.03%	0.01%	0.01%	0.02%	0.01%

Figure 62: frequency control ancillary service prices and costs for the mainland


The total cost of ancillary services in Tasmania for the week was \$77 000 or 1 per cent of the total turnover in the energy market in Tasmania. Figure 63 summarises for Tasmania the prices and costs for the eight frequency control ancillary services.

	Raise 6 sec	Raise 60 sec	Raise 5 min	Raise Reg	Lower 6 sec	Lower 60 sec	Lower 5 min	Lower reg
Last week (\$/MW)	3.50	1.06	1.41	2.31	0.03	0.35	1.22	0.91
Previous week (\$/MW)	4.09	0.73	1.30	2.07	46.73	1.02	0.62	0.70
Last quarter (\$/MW)	4.97	0.49	2.93	3.00	12.67	0.43	0.82	0.45
Market Cost (\$1000s)	\$19	\$15	\$20	\$13	\$0	\$1	\$3	\$6
% of energy market	0.20%	0.16%	0.21%	0.14%	0.01%	0.01%	0.03%	0.06%

Figure 63: frequency control ancillary service prices and costs for Tasmania

Figure 64 shows the daily breakdown of cost for each frequency control ancillary service.


Figure 64: daily frequency control ancillary service cost

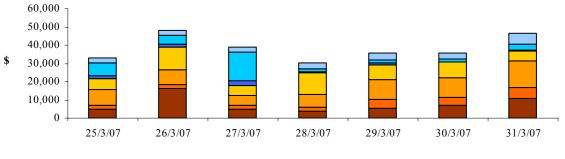

■ Raise 6sec ■ Raise 60sec ■ Raise 5min ■ Raise Reg. ■ Lower 6sec ■ Lower 60sec ■ Lower 5min ■ Lower Reg

Figure 65 shows the contribution, on a percentage basis, that frequency control ancillary service providers are utilised (in each mainland region) to satisfy the total requirement for each service.

Figure 65: regional participation in ancillary services on the mainland

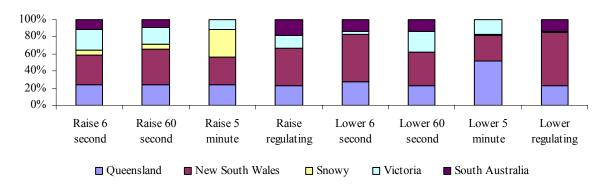

Figures 66 and 67 show 30-minute prices for each frequency control ancillary service throughout the week.

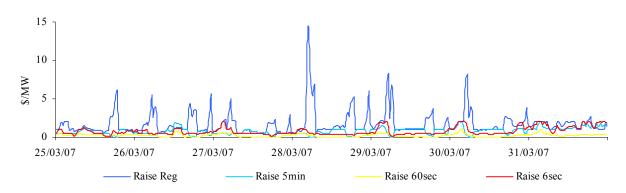
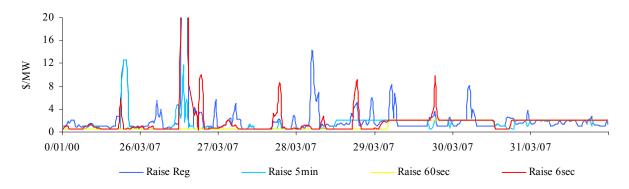



Figure 66A: prices for raise services – Tasmania







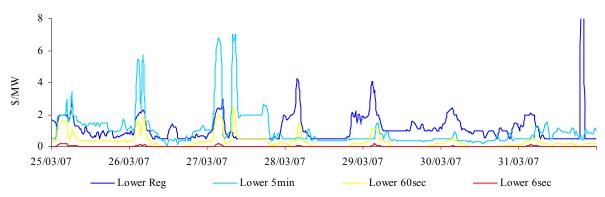


Figure 67A: prices for lower services – Tasmania

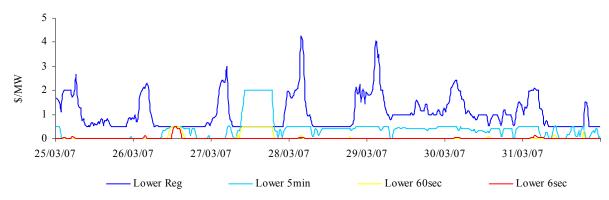

© Commonwealth of Australia.

Figures 68 and 69 present for both raise and lower frequency control services the requirement, established by NEMMCO, for each service to satisfy the frequency standard.



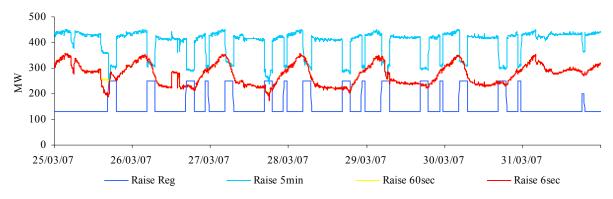
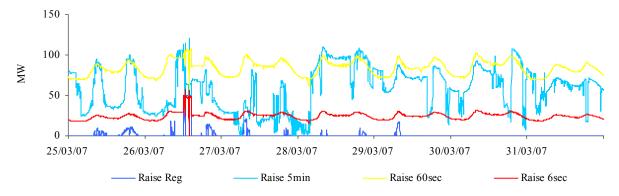



Figure 68A: raise requirements – Tasmania






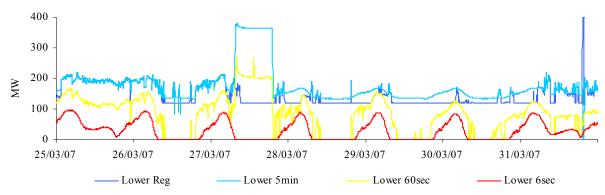


Figure 69A: lower requirements – Tasmania

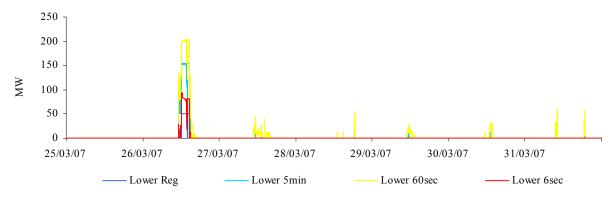

Australian Energy Regulator April 2007

© Commonwealth of Australia.